Fig1

Values of the cost functional and control parameters for the first 1000 iterations with CONT and initial control parameters equal to 0

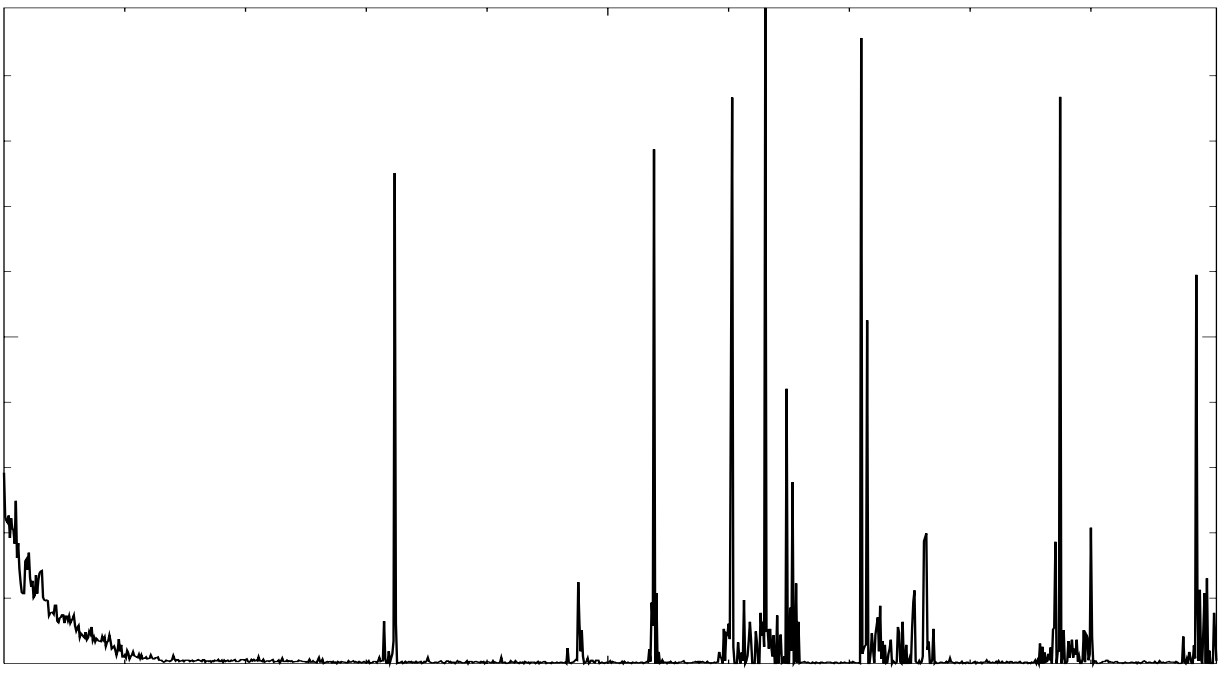

1

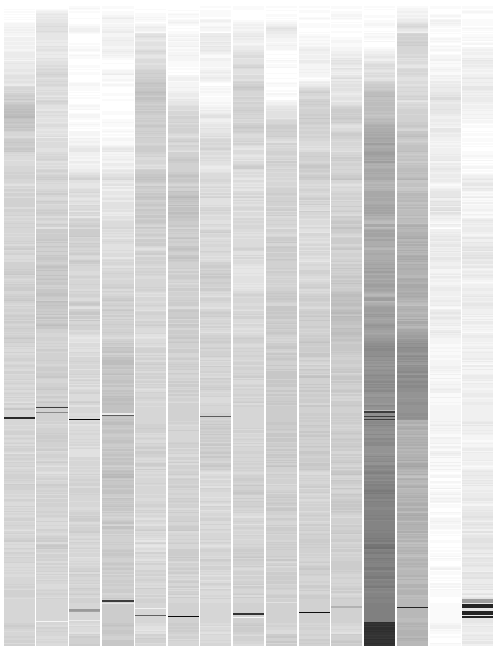

500

501

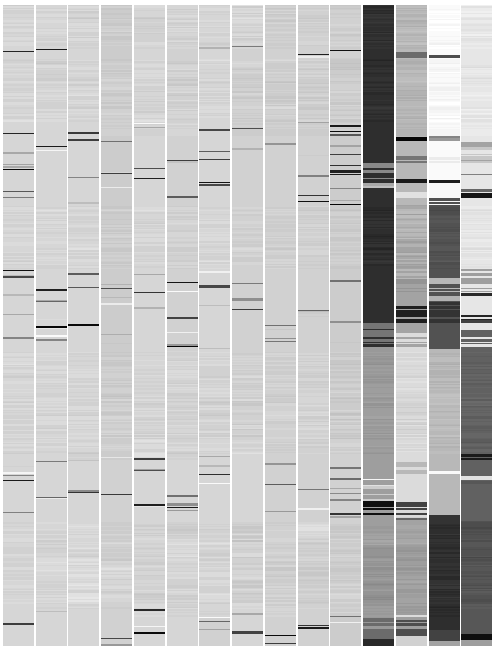

1000